SE1019

ACTUATOR INTERNAL WIRING

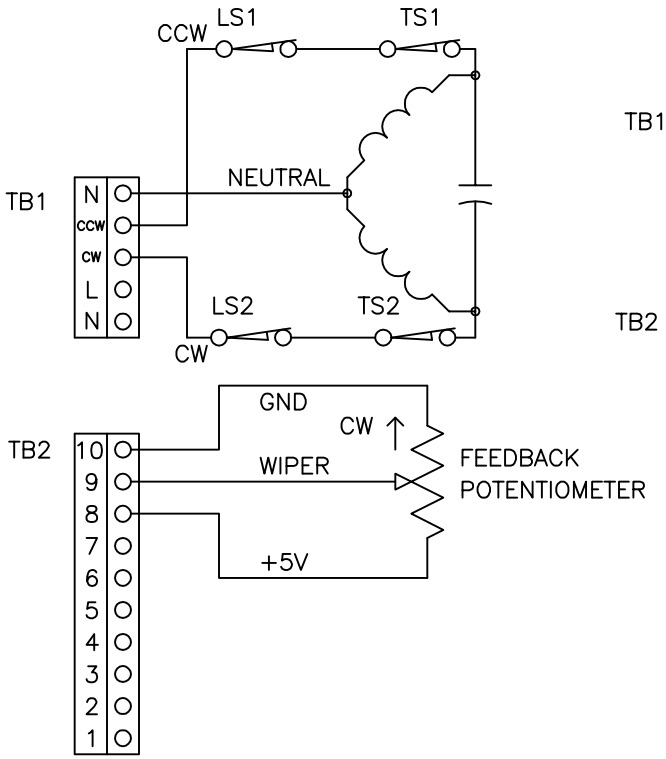

CUSTOMER CONNECTIONS (STANDARD INPUTS)

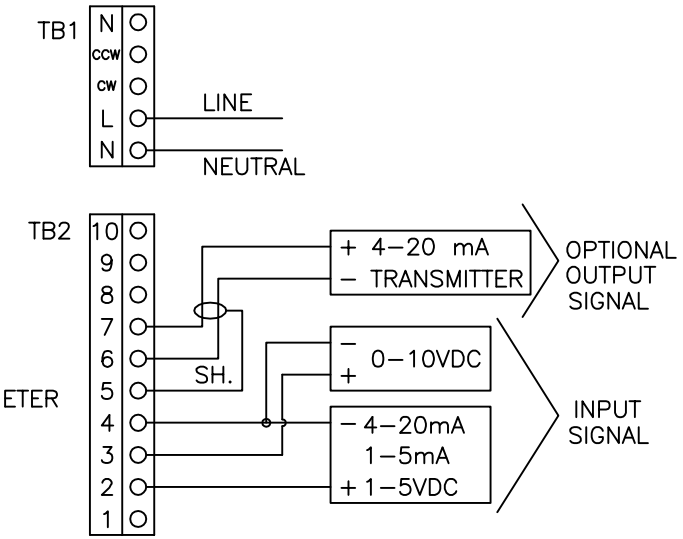

CUSTOMER CONNECTIONS (0–135ohm POTENTIOMETER INPUT)

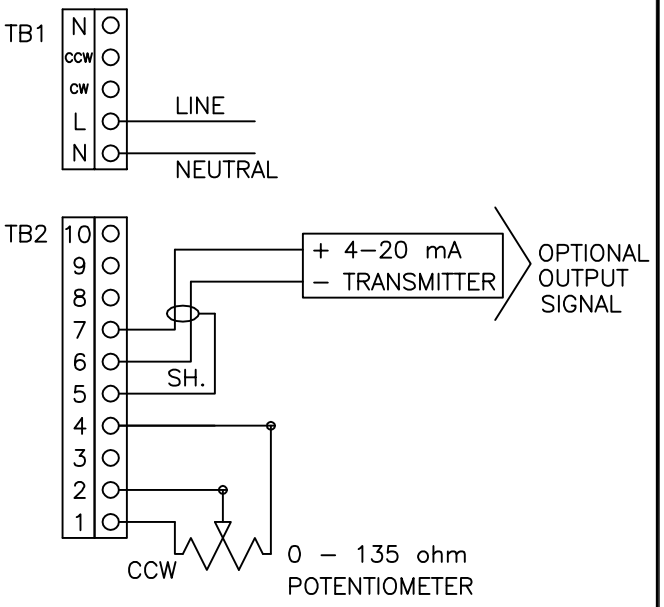

NOTE:
WHEN USING 0-135 OHM INPUT:
JP1 MUST BE MOVED TO 0-10V/SW AND
JP2 MUST BE MOVED TO SW

ECN	DATE	BY
ECN#	DATE	BY

THE DESIGN AND DISCLOSURE CONTAINED IN THIS DRAWING WAS ORIGINATED BY, AND IS EXCLUSIVE PROPERTY OF A-T CONTROLS, INC. IT IS FURNISHED FOR VENDOR INFORMATION ONLY AND IS NOT AN AUTHORIZATION -OR- LICENSE TO MAKE THIS CONSTRUCTION OR TO FURNISH THIS INFORMATION TO OTHERS. ALL DRAWINGS MUST BE RETURNED TO A-T CONTROLS, INC. ON DEMAND. THIS DRAWING IS NOT TO BE REPRODUCED OR COPIED IN ANY FORM WITHOUT THE EXPRESS WRITTEN PERMISSION OF A-T CONTROLS, INC.

TRIAC CONTROLS

Division of A-T Controls, Inc.
11363 Deerfield Road
Cincinnati, Ohio 45242
Phone: (513) 247-5465
Fax: (513) 247-5462

DRAWN	CHECKED BY	APPROVED
SAH		
DATE	DATE	DATE
01/07/04		

TITLE
TMC2 (TRIAC MODULATING CARD)
WIRING DIAGRAM